

SINTEF Technical Approval

TG 20872

Issued first time: 04.07.2024
 Revised:
 Amended: 20.11.2025
 Valid until 01.07.2029
 Provided listed on
www.sintefcertification.no

SINTEF confirms that

SikaShield® E65 double-layer roof waterproofing membrane

has been found to be fit for use in Norway and to meet the provisions regarding product documentation given in the regulation relating to the marketing of products for construction works (DOK) and regulations on technical requirements for building works (TEK), with the properties, fields of application and conditions for use as stated in this document



1. Holder of the approval

Sika Services AG
 Tüffenwies 16
 8048 Zürich
 Switzerland
www.sika.com

2. Product description

SikaShield® E65 double-layer roof waterproofing membrane is a double layer bituminous roofing system where the top layer is fully torched to the underlay. The double layer system consists of:

Underlay: SikaShield® E65 S 2,5 mm
 Top layer: SikaShield® E65 MG FR 4 mm

SikaShield® E65 S 2,5 mm consists of SBS modified bitumen with a non-woven reinforcement of Spunbond polyester and has a top surface coated with sand, which ensures bond of the overlying layers. The underside has a thin plastic film that will melt away during torching.

SikaShield® E65 MG FR 4 mm consists of SBS modified bitumen with a non-woven reinforcement of Spunbond polyester and has a top surface coated with granules. The underside has a thin plastic film that will melt away during torching. SikaShield® E65 MG RF 4 mm can be delivered in different colours. Standard colours are grey and black.

Measures and tolerances for the two membranes are given in table 1.

Table 1

Measures and tolerances for SikaShield® E65 MG FR 4 mm and SikaShield® E65 S 2,5 mm according to EN 1848-1 and EN 1849-1

| Property | SikaShield® E65 S 2,5 mm | SikaShield® E65 MG FR 4 mm | Unit | Tolerance |
|-------------------------|--------------------------|----------------------------|-------------------|-------------|
| Thickness | 2.5 | 4.0 | mm | ± 5 % |
| Area weight | 3.0 | 5.0 | kg/m ² | ± 10 % |
| Width | 1 | 1 | m | ± 1 % |
| Length of roll | 10 | 8 | m | - 0 / + 2 % |
| Weight of reinforcement | ca. 150 | ca. 180 | g/m ² | - |

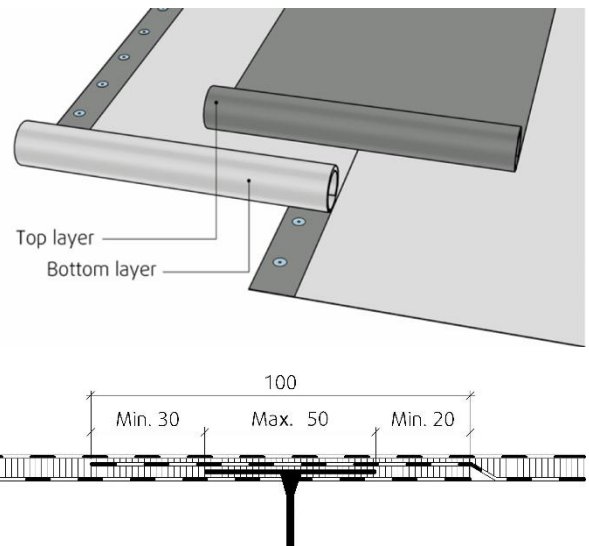


Fig 1

SikaShield® E65 double-layer roof waterproofing membrane. The top layer is fully bonded by welding to the mechanically fixed underlay.

3. Fields of application

SikaShield® E65 double-layer roof waterproofing membrane can be used for covering pitched and flat roofs. It can be used both on new buildings and in rehabilitation projects. The system is designed especially for use as mechanically fixed double-layer roofing membrane, see fig. 1.

Roofs must have adequate slope to drain water from rain and melted snow. SINTEF recommends in general a minimum slope of 1:40 for all roofs.

4. Properties

Product properties

Product properties for fresh material are shown in table 2.

Properties related to fire

SikaShield® E65 double-layer roof waterproofing membrane fulfils the requirements of fire class B_{ROOF} (t2) according to EN 13501-5 regarding external fire performance on substrates shown in table 3. Testing is performed according to CEN/TS 1187, test 2.

SINTEF is the Norwegian member of European Organisation for Technical Assessment, EOTA, and European Union of Agrément, UEAtc

Table 2

Product properties for fresh material for products in SikaShield® E65 double-layer roof waterproofing membrane

| Property | Test method EN | SikaShield® E65 S 2,5 mm Underlay | | SINTEF's recommended minimum performance ³⁾ | SikaShield® E65 MG FR 4 mm Top layer | | SINTEF's recommended minimum performance ⁴⁾ | Unit | |
|--|------------------------|---|--------------------------------|---|--|--------------------------------|---|---------------|----------|
| | | DoP ¹⁾ | Control limit ²⁾ | | DoP ¹⁾ | Control limit ²⁾ | | | |
| Dimensional stability | 1107-1 | - | 0.6 | ± 0.6 | - | ± 0,6 | ± 0.6 | % | |
| Flexibility at low temperature | 1109 | Upper face out Lower face out | ≤ -20 ≤ -20 | ≤ -15 ≤ -15 | ≤ -20 - | ≤ -20 - | ≤ -15 - | °C | |
| Flow resistance at elevated temperature | 1110 | - | ≥100 | ≥ 90 | - | ≥100 | ≥ 90 | °C | |
| Watertightness 10 kPa/24 h | 1928 (A) | Tight | Tight ⁶⁾ | Tight | Tight | Tight ⁶⁾ | Tight | - | |
| Adhesion of granules ⁵⁾ | 12039 | - | - | - | - | ≤ 2,5 g ⁵⁾ | ≤ 2.5 g ⁵⁾ | - | |
| Resistance to tearing (nail shank) | 12310-1 | L T | 215 ± 65 ≥ 150 | ≥ 150 | 250 ±75 300 ±90 | - - | - - | N | |
| Tensile strength | 12311-1 | L T | 750 ± 150 600 ± 120 | ≥600 ≥480 | ≥ 400 | 850 ± 170 700 ± 170 | ≥ 600 ≥ 600 | ≥ 400 | N/50 mm |
| Elongation at max load | 12311-1 | L/T | 45 ±15 % | ≥ 30 | ≥ 10 | 45 ±15% | ≥ 30 | ≥ 10 | % |
| Average peel resistance of joints Sidlap/Endlap | 12316-1 | - | 100 ±20 | 80 | ≥ 50 | - | - | - | N/50 mm |
| Shear resistance of joints Sidlap Endlap | 12317-1 | - | 600 ±120 500 ± 100 | ≥480 ≥400 | ≥ 400 | 600 ±150 850 ±150 | - | - | N/50 mm |
| Resistance to: Impact +23 °C Static loading | 12691 (A) 12730 (A) | - | ≥ 500 ≥ 15 | ≥500 15 | ≥ 500 ≥ 15 | ≥ 1000 ≥ 20 | ≥ 1000 ≥ 20 | ≥ 500 ≥ 15 | mm kg |
| Watertightness after 10 % elongation at -10 °C | 13897 | - | - | - | - | Pass ⁶⁾ | Pass | - | |

¹⁾ The manufacturers Declaration of Performance, DoP²⁾ Control limits show the values the product has to satisfy during internal factory production control and audit testing³⁾ SINTEF's recommended minimum performance in SINTEF Technical Approval for the underlay in double layer system⁴⁾ SINTEF's recommended minimum performance in SINTEF Technical Approval for the top layer in double layer system⁵⁾ Modified to give the result of weight loss of granules in gram⁶⁾ Result from type testing

L = Longitudinal

T = Transversal

Table 3

SikaShield® E65 double-layer roof waterproofing membrane has fire classification B_{ROOF} (t2) on following substrates

| Type of substrate | SikaShield® E65 double-layer roof waterproofing membrane |
|---|---|
| EPS ^{1) 2)} | Yes |
| Mineral wool ¹⁾ | Yes |
| Wood particle board ¹⁾ | Yes |
| Concrete / calcium silicate plate ¹⁾ | Yes |
| Old roofing membrane on EPS ²⁾ | Yes |
| Old roofing membrane on mineral wool | Yes |
| Old roofing membrane on wood particle board | Yes |
| Old roofing membrane on concrete / calcium silicate plate | Yes |

¹⁾ Standard substrate according to CEN/TS 1187, test 2.²⁾ In case of roofing on combustible insulation (eg EPS):

See clause 6 Special conditions for use and installation, section Substrate, regarding requirements for replacement of combustible insulation to non-combustible around passages and against adjacent structures.

For more information regarding fire property requirements for roofing, see TPF informerer nr. 6 *Branntekniske løsninger for kompakte tak og terrasser* published by Takprodusentenes Forskningsgruppe (TPF), see www.tpf-info.org.

Durability

SikaShield® E65 S 2,5 mm and SikaShield® E65 MG FR 4 mm have shown satisfying properties after artificial ageing in connection with type-testing and audit testing performed by SINTEF.

Fastening capacity

The design capacity for the fastening of the membrane with fasteners and premises is given in table 4. The capacity applies to the connection between the membrane and the fasteners according to EN 16002.

For weak substrates the connection between the substrate and the fastener might limit the capacity. This must be considered.,

Calculation of fasteners' spacing is carried out according to SINTEF Building Research Design Guide no. 544.206 *Mekanisk innfesting av asfalttakbelegg og takfolie på skrån og flate tak* and "TPF informerer nr. 5 *Innfesting av fleksible takbelegg, dimensjonering og utførelse*" published by Takprodusentenes Forskningsgruppe (TPF), see www.tpf-info.no. It is not possible to assume increased wind load capacity by decreasing the distance between the fasteners; due to uncertainty in the type of failure, ref. EAD 030351-00-0402 Annex 1. The lowest capacity for attachment in the membrane / substrate must always be used for the calculation.

Table 4
Design capacity at ultimate limit state for the attachment of SikaShield® E65 double-layer roof waterproofing membrane

| Fastener/Fastening system, Fastening in minimum 100 mm welded overlap | Design capacity N/fastener ¹⁾ |
|--|---|
| SFS RP 50 x 60 plastic washer and SFS BS-4,8 screw Tested on soft substrate, attachment in 0,75mm steel plate, $f_y = 320$ N/mm ² Distance between fasteners: C/C 320 mm | 800 |

¹⁾ Measured according to method EN 16002 and the safety factor $\gamma_m = 1,5$ according to EAD 030351

5. Environmental aspects

Substances hazardous to health and environment

SikaShield® E65 double-layer roof waterproofing membrane contains no hazardous substances with priority in quantities that pose any increased risk for human health and environment. Chemicals with priority include CMR, PBT or vPvB substances.

Effect on soil, surface water and ground water

The leaching properties of SikaShield® E65 double-layer roof waterproofing membrane are evaluated to have no negative effects on soil or water.

Waste treatment/recycling

SikaShield® E65 double-layer roof waterproofing membrane shall be sorted as residual waste. The product shall be delivered to an authorized waste treatment plant for energy recycling.

Environmental declaration

No environmental declaration (EPD) has been worked out for SikaShield® E65 double-layer roof waterproofing membrane.

6. Special conditions for use and installation

Installation

The underlay SikaShield® E65 S 2,5 mm shall be mechanically fastened with overlaps of minimum 100 mm which are welded over the entire width. The fasteners must be positioned at a distance from the membrane edges that provides minimum 20 mm bonding on the inside and minimum 30 mm bonding on the outside of the fastener, see figure 1.

The top layer SikaShield® E65 MG FR 4 mm shall be installed with 100 mm welded overlaps and the sheets shall be fully welded to the underlay SikaShield® E65 S 2,5 mm. The longitudinal overlaps of SikaShield® E65 MG FR 4 mm shall be positioned on the middle of the underlay, see fig. 1.

Transverse joints must have an overlap of minimum 150 mm. The underlying corner is fastened, and the overlying corner is cut at an angle. A good result is achieved by 'drowning' the granules of the surface in bitumen before the joint is fully welded.

Welding is performed with with gas flame or hot air. TPF Informerer no. 6 *Branntekniske løsninger for kompakte tak og terrasser* describes which roofing methods can be used on various roof structures. When roofing with hot air or open flame, all combustible insulation must in principle be protected with non-combustible insulation. However, TPF Informerer no. 6 describes exceptions for hot air welding of roofing membranes with fire class B_{ROOF} (t2).

The roofing membrane shall generally be installed in accordance with the vendor's installation manual and the principles shown in SINTEF Building Research Design Guide no.

- 544.203 *Asfalttakbelegg. Egenskaper og tekking*
- 544.204 *Tekking med asfalttakbelegg eller takfolie. Detaljløsninger*
- 544.206 *Mekanisk feste av asfalttakbelegg og takfolie på flate tak*

plus information sheets issued by Takprodusentenes Forskningsgruppe (TPF), see www.tpf-info.org:

- TPF informerer nr. 5 *Innfesting av fleksible takbelegg, dimensjonering og utførelse*
- TPF informerer nr. 6 *Branntekniske løsninger for kompakte tak og terrasser*
- TPF informerer nr. 13 *Tak under oppføring – forholdsregler og tiltak ved bruk*

Fasteners

Normal steel washers may be used in longitudinal overlapping joints on firm substrates such as wood-based roof sheathing or concrete.

On substrates of thermal insulation with compressive strength ≥ 80 kN/m² (level CS(10)80 according to EN 13162/13163) steel washers with deep collars or plastic washers should be used.

Washers with integrated sleeves and good telescopic function must be used for installation on thermal insulation with lower compression strength, and the tightening of the fasteners must particularly be checked.

Substrate

When a fire classification is required the substrate must be in accordance with the provisions stated in clause 4 regarding *Properties related to fire*.

Substrates of combustible insulation, such as EPS, must be covered or divided into areas, and replaced with non-combustible insulation around bushings and adjacent constructions, such as parapets and walls, according to pre-accepted performances given in the guidance to *forskrift om tekniske krav til byggverk § 11-9* and in TPF informerer nr. 6 *Branntekniske løsninger for kompakte tak og terrasser*.

Traffic on the roof

Special precautionary measures should be taken to protect the roofing membrane if the roof is expected to have more traffic than is necessary for inspection and maintenance purposes only.

Cleaning and maintenance

Before starting any welding, as a part of repair work, the roofing membrane must be cleaned locally, in accordance with the manufacturer's guidelines.

Transport and storage

SikaShield® E65 S 2,5 mm and SikaShield® E65 MG FR 4 mm must be transported in a manner that does not damage the product and stored upright on pallets or on a smooth, flat surface.

7. Factory production control

SikaShield® E65 double-layer roof waterproofing membranes are produced in Italy for Sika Services AG.

The holder of the approval is responsible for the factory production control in order to ensure that the products are produced in accordance with the preconditions applying to this approval.

The manufacturing of the products is subject to continuous surveillance of the factory production control in accordance with the contract regarding SINTEF Technical Approval.

The manufacturer has a quality management system certified according to EN ISO 9001, and an environmental management system certified according to EN ISO 14001.

8. Basis for the approval

The evaluation of SikaShield® E65 double-layer roof waterproofing membranes is based on reports owned by the holder of the approval.

The evaluation of design and technical solutions are based on recommendations given in SINTEF Building Research Design Guides.

9. Marking

All rolls shall be marked with producer, product name and batch number.

The products are CE marked in accordance with EN 13707.

The approval mark for SINTEF Technical Approval TG 20872 may also be used.

10. Liability

The holder/manufacturer has sole product responsibility according to existing law. Claims resulting from the use of the product cannot be brought against SINTEF beyond the provisions of Norwegian Standard NS 8402

for SINTEF



Hans Boye Skogstad
Approval Manager